

**A STUDY ON INDUSTRIAL COMMUNICATION NETWORKING:  
ETHERNET BASED IMPLEMENTATION**

**HAIRULAZWAN BIN HASHIM**

A project report is submitted as partial fulfillment of the requirements for  
the award of the degree of  
**Master of Electrical Engineering**

Faculty of Electrical and Electronic Engineering  
Kolej Universiti Teknologi Tun Hussein Onn

NOVEMBER, 2006

*For my beloved wife,  
Norasiah binti Md Aspan*

*My father and mother,  
Hashim bin Mohd Said and Uminah binti Kaseran@Hj. Yusof*

*My family,  
Zainita, Mohd Rizal, Mohd Nazree, Norzela, Mohd Haizam, Md Syfulnizam,  
Noorzalila, Siti Norida, Mohd Salehudin, Siti Nordinah and Mohd Syafiq  
for their encouragement, support, caring and blessing...*



PTTA UTHM  
PERPUSTAKAAN TUNGU TUNJANGAN AMINAH

## ACKNOWLEDGEMENT

Alhamdulillah, I am grateful to ALLAH S.W.T on His blessing in completing this project.

I am deeply grateful for the help that I received from my supervisor, Associate Professor Dr. Zainal Alam bin Haron during this development of this project. His willingness to help and ideas has kept me on my toes from the beginning stage of this project until the completion of this thesis.

I could not have done this project without the unconditional support, active encouragement, complete cooperation, and honest sacrifice by my wife, Norasiah binti Md Aspan and family. To appreciate their immense contribution, this thesis is lovingly dedicated to them.

I am also indebted to Kolej Universiti Teknologi Tun Hussein Onn (KUiTTHO) and Jabatan Perkhidmatan Awam (JPA) for supporting me in the form of a scholarship and study leave.

I would also like to extend my gratitude to all lecturers and technician that has given me all the basic needed for completing this project, and also to my classmates, friend, colleagues and who helped me directly or indirectly for their encouragement and help. Their views and tips are useful indeed. Unfortunately, it is not possible to list all of them in this limited space.

## ABSTRACT

Recent enhancement of the industrial communication and networking has made it possible to apply Ethernet networks at all levels of industrial automation, especially at controller level where the data exchange in real-time communication is mandatory. This report presents a study on the development of industrial communication network based on the Ethernet and thus implementation towards Computer Integrated Manufacturing (CIM) system. The Ethernet module is installed onto supervisory OMRON PLC to integrate the various stations in the CIM-70A system which located at Robotic Laboratory in KUiTTTHO. The workability of this communication technique was analyzed and compared with the conventional serial communication which widely used in automation networking systems. Through this approach, the communication and integration of CIM systems can be accessed easily and hence available to be upgraded to the management and enterprise levels of automation.



PERPUSTAKAAN FUNKSI TUNJUNG AMINAH

## ABSTRAK

Penambahan penggunaan rangkaian Ethernet sejak akhir-akhir ini telah menjadikannya boleh diaplikasikan di semua peringkat automasi perindustrian, terutamanya di tahap pengawal di mana penukaran data dalam masa nyata adalah mandatori. Kertas kerja ini membentangkan satu kajian pembangunan perindustrian rangkaian komunikasi berdasarkan Ethernet dan seterusnya akan diaplikasikan kepada sistem pembuatan komputer bersepadu (CIM). Modul Ethernet telah dipasangkan kepada pengawal logik boleh aturcara (PLC) jenama OMRON (siri CJ1M) untuk menyepadukan pelbagai stesen pengeluaran didalam sistem CIM-70A yang berada di Makmal Robotik, KUiTTHO. Keboleherjaan teknik komunikasi ini telah dianalisis dan dibandingkan dengan sistem konvensional yang begitu meluas digunakan di dalam rangkaian sistem automasi iaitu komunikasi bersiri. Menerusi pendekatan ini, komunikasi dan integrasi sistem CIM lebih mudah dicapai dan seterusnya boleh dipertingkatkan ke peringkat pengurusan dan perusahaan di dalam sistem automasi.



## TABLE OF CONTENTS

CHAPTER	TITLE	PAGE
	<b>DECLARATION</b>	ii
	<b>DEDICATION</b>	iii
	<b>ACKNOWLEDGEMENT</b>	iv
	<b>ABSTRACT</b>	v
	<b>ABSTRAK</b>	vi
	<b>TABLE OF CONTENTS</b>	vii
	<b>LIST OF TABLES</b>	xi
	<b>LIST OF FIGURES</b>	xii
	<b>LIST OF ABBREVIATIONS</b>	xiv
	<b>LIST OF APPENDICES</b>	xvi
<b>I</b>	<b>INTRODUCTION</b>	<b>1</b>
	1.1 Project Overview	1
	1.2 Problem Statement	2
	1.3 Objective	3
	1.4 Scope of Work	3
	1.5 Thesis Layout	4



PTM UTHM  
PERPUSTAKAAN TUN AMINAH

<b>CHAPTER</b>	<b>TITLE</b>	<b>PAGE</b>
<b>II</b>	<b>LITERATURE REVIEW</b>	<b>5</b>
2.1	Introduction of Industrial Communication	5
2.2	Fieldbuses Standard	7
2.3	Real-time Communication Evolution	9
2.4	Industrial Ethernet	10
<b>III</b>	<b>INDUSTRIAL ETHERNET COMMUNICATION AND NETWORKING</b>	<b>16</b>
3.1	Ethernet Background	16
3.1.1	Ethernet and the OSI Model	16
3.1.2	Ethernet Frame Format	17
3.2	Ethernet System Configuration and Devices	18
3.2.1	Ethernet Station Interface	19
3.2.2	Twisted-pair Cables	19
3.2.3	Switched Ethernet	20
3.3	OMRON Communication and Networking	21
3.4	OMRON PLC and OSI Model	23
3.4.1	Application Layer	25
3.4.2	Transport Layer	26
	3.4.2.1 FINS/UDP Method	26
	3.4.2.2 FINS/TCP Method	28
3.4.3	Network Layer	30
	3.4.3.1 IP Address Configuration	30
	3.4.3.2 Subnet Masks Configuration	31
3.4.4	Physical Layer	32
3.4.5	FINS Communications	33
3.5	OMRON Network Instructions	34

<b>CHAPTER</b>	<b>TITLE</b>	<b>PAGE</b>
<b>IV</b>	<b>HARDWARE INSTALLATION AND SOFTWARE DEVELOPMENT</b>	<b>36</b>
4.1	Introduction	36
4.2	CIM-70A System	37
4.2.1	Introduction of CIM-70A System	37
4.2.2	Communication Networking of CIM-70A System	38
4.2.3	Real-Time Monitoring of CIM-70A System	39
4.2.3.1	OMRON CX-Programmer	40
4.2.3.2	Citect SCADA	40
4.2.3.3	ASRS HMI	41
4.3	Hardware Installation	42
4.3.1	Ethernet Module Installation	43
4.3.2	Communications Test	45
4.4	Software and Programming Development	47
4.4.1	Introduction	47
4.4.2	Programming Development	47
<b>V</b>	<b>RESULTS AND ANALYSIS</b>	<b>52</b>
5.1	Introduction	52
5.2	System Setup and Memory Allocations	52
5.3	Communication Test	54
5.4	Real-time Monitoring	55



<b>CHAPTER</b>	<b>TITLE</b>	<b>PAGE</b>
<b>VI</b>	<b>CONCLUSIONS AND RECOMMENDATIONS</b>	<b>59</b>
6.1	Conclusion	59
6.2	Recommendations for Future Development	60
	<b>REFERENCES</b>	<b>61</b>
	<b>APPENDICES</b>	<b>65</b>



**PTTA UTHM**  
PERPUSTAKAAN TUNKU TUN AMINAH

## LIST OF TABLES

TABLE NO.	TITLE	PAGE
2.1	Characteristic of some standard fieldbuses	8
2.2	Some of the Ethernet network types	11
3.1	OMRON PLC communication network comparison	21
3.2	Subnet Mask classification	32
3.3	Ethernet version 2.0 and IEEE 802.3 standard	33
3.4	OMRON network instructions; SEND(090) and RECV(098)	34
3.5	Control words format	35
4.1	CIO memory area of CIM-70A system	39
4.2	Ethernet module setup for CIM-70E system	44
4.3	Control data for ASRS Station in Conveyor System Station PLC program	49
4.4	Control data created in Conveyor System Station PLC program	50
4.5	Control data created in Station PLC program	50
5.1	IP and MAC addresses for CIM-70E system	53
5.2	CIO memory area comparison	54
5.3	Communication test results	55

## LIST OF FIGURES

FIGURE NO.	TITLE	PAGE
1.1	Pyramid of industrial automation system	2
3.1	OSI model comparison	17
3.2	Standard Ethernet frame format	17
3.3	Ethernet basic configuration	18
3.4	Ethernet module, ETN-21	19
3.5	Ethernet network method using hub/switch	20
3.6	Ethernet OSI model	23
3.7	FINS command architecture	24
3.8	FINS command and response	25
3.9	FINS/UDP method	27
3.10	FINS/TCP method	28
3.11	IP address classification	30
3.12	Subnet Mask example	32
3.13	Ethernet version 2.0 and IEEE 802.3 configuration	33
3.14	FINS communication architecture	34
4.1	Overall CIM-70A system layout	37
4.2	CIM-70A system networking	38
4.3	Complete Link method of CIM-70A system	39
4.4	Rack status of ASRS HMI	41
4.5	CIM-70E system networking	42
4.6	Overview of Ethernet module installation procedure	43
4.7	PING command	45
4.8	Example of PING command	46

<b>FIGURE NO.</b>	<b>TITLE</b>	<b>PAGE</b>
4.9	A main parts of ladder program for Conveyor System Station	48
5.1	IP and MAC addresses scanning	53
5.2	PING command results	54
5.3	Online monitoring through CX-Programmer window	57



## LIST OF ABBREVIATIONS

ACK	-	acknowledgement
ARP	-	address resolution protocol
ASRS	-	automatic storage and retrieval system
AUI	-	attachment unit interface
BACNet	-	building automation and control network
CAN	-	controller area network
CD	-	compact disc
CIM	-	computer integrated manufacturing
CiN	-	CAN in automation
CIO	-	common input/output
COM	-	component object model
DCOM	-	distributed component object model
DEC	-	Digital Electronic Corporation
DIX	-	DEC, Intel, and Xerox
DM	-	digital memory
DNS	-	domain name system
EHS	-	European Home System
ERP	-	entrepreneurs resources planning
FA	-	field assembly
FF	-	Foundation Fieldbus
FINS	-	factory interface network service
FINS/TCP	-	factory interface network service/transmission control protocol
FINS/UDP	-	factory interface network service/user datagram protocol
FIP	-	factory instrumentation protocol
FKEE	-	Faculty of Electrical and Electronic Engineering

FTP	-	file transfer protocol
HART	-	Highway Addressable Remote Transducer
HMI	-	human machine interface
ICMP	-	internet control message protocol
IDA	-	interface for distributed automation
IEEE	-	Institute of Electrical and Electronic Engineer
IEC	-	International Electrotechnical Commission
IP	-	internet protocol
ISA	-	Instrument Society of America
ISP	-	interoperable system project
KUiTTHO	-	Kolej Universiti Teknologi Tun Hussein Onn
LAN	-	local area network
LLC	-	logical link control
LonWorks	-	local operating networks
MAC	-	medium access control
MAU	-	multi-station access unit or medium attachment unit
MES	-	manufacturing execution system
MRP	-	material requirement planning
MRP-II	-	manufacturing resources planning
NIC	-	network interface card
OSI	-	open system interconnection
PC	-	personal computer
PID	-	proportional, integral and derivative
PING	-	packet internet groper
PLC	-	programmable logic controllers
POP3	-	post office protocol version 3.0
Profibus	-	Process Fieldbus
SCADA	-	supervisory control and data acquisition
ScTP	-	screened twisted-pair cable
SDS	-	smart distributed system
SMTP	-	simple mail transfer protocol
SNTP	-	simple network time protocol
STP	-	shielded twisted-pair cable
TCP	-	transmission control protocol

TCP/IP	-	transmission control protocol/internet protocol
UDP	-	user datagram protocol
UTP	-	unshielded twisted-pair cable



## LIST OF APPENDICES

APPENDIX NO.	TITLE	PAGE
<b>A</b>	<b>OMRON CJ Series Manuals</b>	<b>65</b>
<b>B</b>	<b>CIM-70A System Operation</b>	<b>67</b>
B.1	System Operation	67
B.2	Master: Conveyor System Station	68
B.3	Station 1: Robot Arm	69
B.4	Station 2: Pick & Place	70
B.5	Station 3: Vision Inspection Station	71
B.6	Automatic Storage and Retrieval System (ASRS) Station	72
<b>C</b>	<b>Ethernet Module Installation</b>	<b>75</b>
C.1	Switch Settings	75
	C.1.1 Setting the Unit Number	76
	C.1.2 Setting the Node Address	76
C.2	Mounting Ethernet Module to a PLC	77
C.3	Creating an Input/Output (I/O) Tables	78
C.4	Ethernet Module Setup Procedure	79
	C.4.1 Using CX-Programmer	79
	C.4.2 Using the Web Browser Setting Function	83
C.5	Creating Routing Tables	86
	C.5.1 Routing Tables Overview	87
	C.5.2 Creating Routing Tables Procedure	88



<b>APPENDIX NO.</b>	<b>TITLE</b>	<b>PAGE</b>
<b>D</b>	<b>OMRON PLC Program</b>	<b>93</b>
D.1	Conveyor System Station Program	93
D.2	ASRS Station Program	97
D.3	Station 1: Robot Arm Program	98
D.4	Station 2: Pick & Place Program	99
<b>E</b>	<b>Attachment CD</b>	<b>100</b>



**PTTA UTHM**  
PERPUSTAKAAN TUNKU TUN AMINAH

## CHAPTER I

### INTRODUCTION

#### 1.1 Project Overview

Data communication and networking may be the fastest growing technology in our culture today (Forouzan, 2001). It is extensively used in an industrial network to integrate both office and manufacturing equipment. During the last two decades, the industrial communication system have evolved at a rapid pace and passed from the traditional serial communication to the fieldbuses. The term fieldbus applies to a large family of two-way digital communication protocols that were specially developed to overcome the physical and performance limitations of low level digital and analogue standard (Sterling and Wissler, 2003). A full fieldbus protocol can handle byte size data for complex transmitters and valves as well as diagnostics or control information. Any control device requiring extensive communication for configuration requires a full fieldbus.

Ethernet, the well-known Local Area Network (LAN) standardized by IEEE has been largely utilized in industrial communication. The Ethernet network have gained the capability of communicating in real-time thus opening an attractive scenario, implementation of Ethernet at all level of an industrial automation system (Figure 1.1).

## 1.2 Problem Statement

Real-time communication has become some major issue in automated manufacturing system. Some problems such as data and status monitoring, transmission data size and speed, online program editing, and accessibility of controller are encountered in conventional serial communication networking such as in Computer Integrated Manufacturing (CIM) system. Furthermore, the integration into higher level of automation system; Manufacturing Resources Planning (MRP-II), Manufacturing Execution System (MES) and Entrepreneurs Resources Planning (ERP) has difficulty to implement (Figure 1.1).

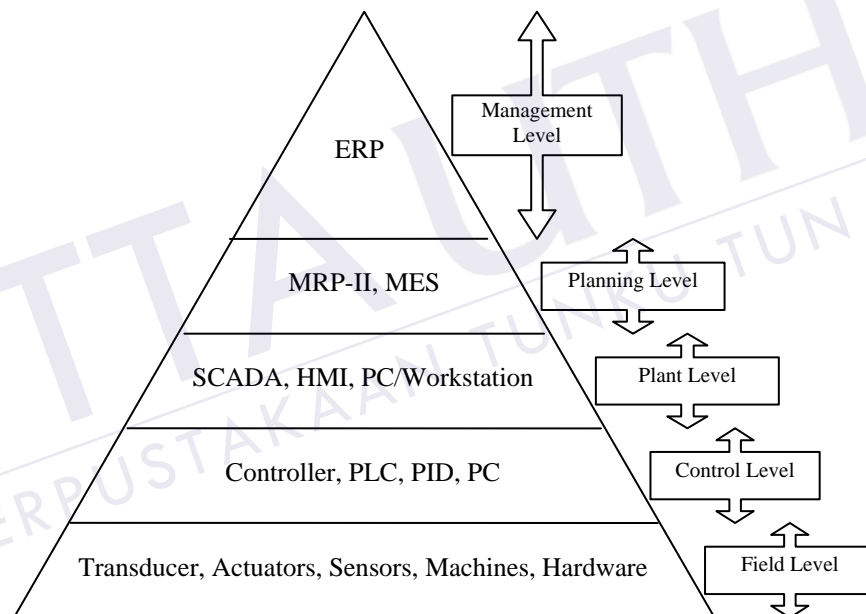


Figure 1.1: Pyramid of industrial automation system

### 1.3 Objective

The objectives of this project are;

- i) To develop a hardware infrastructure of CIM system communication network based on Ethernet protocol.
- ii) To familiarize and thus overcome real-time monitoring issues so that allows easier integration between the different units of the CIM systems via Ethernet module on OMRON PLC CJ-series.
- iii) To verify and validate the functionality, feasibility and workability of the project.

### 1.4 Scope of Work

This project is concentrating to develop a CIM system communication network based on the Ethernet protocol. The work will involve using OMRON PLC controller (CJ Series) attached with Ethernet module to integrate the various production units in the CIM system including supervisory workstation. The environment of this implementation is established CIM-70A systems developed in the Robotics Laboratory, Faculty of Electrical and Electronic Engineering (FKEE), Kolej Universiti Teknologi Tun Hussein Onn (KUiTTHO).

## 1.5 Thesis Layout

This thesis is organized as follows: Chapter 1 explains the overall background of the study. A quick glimpse of study touched in first sub-topic. The heart of study such as objective, problem statement and project scope as limitation of this project and thesis layout is presented well through this chapter.

Chapter 2 will cover the literature research based on industrial Ethernet communication background, development and implementation. Chapter 3 explains and discusses the overall concept and issues in Ethernet communication network as well as manufacturer offered technique i.e. OMRON to overcome a real-time communication issues.

Chapter 4 presents the methodology used to implement Ethernet based communication in terms of hardware installation and software development. The current CIM-70A system setup is explained first. Further detailed explanations are attached in appendices.

Chapter 5 will reports and discuss on the results obtained that reflect my problem statements as stated in first chapter. The results from communication test and real-time monitoring performance based on Ethernet communication network will be analyzed with helps from set of figures and tables.

Chapter 6 will go through about the conclusion and recommendation for future works. This entire thing is done after completing my dissertation. References cited, and supporting appendices are given at the ends of this thesis while a documentation CD also available and attached on this thesis back cover for future reference.

## CHAPTER II

### LITERATURE REVIEW

#### 2.1 Introduction of Industrial Communication

Industrial communication protocol also known as fieldbus is a communication network bus at a low level industrial control and instrument devices. According to the definition of International Electrotechnical Commission (IEC) and Instrument Society of America (ISA), a fieldbus is a digital, serial, multi-drop, data bus for communication with low-level industrial control and instrumentation devices such as transducers, actuators and local controllers. Fieldbuses are serial information transfer buses used in industry, oriented to data transmission in discrete and continuous processes. Before the appearance of fieldbuses, the connections between process units; Programmable Logic Controllers (PLC), and field devices; sensors, actuators, etc., were point-to-point links. It meant complex and expensive installations. Also the maintenance and modification tasks were harder.

These problems are solved with fieldbuses, because all devices are connected through a single physical medium; twisted pair, coaxial, two wires, optical fiber, etc., extended over the whole area of the distributed control process system. So, new devices can be added, connecting to the fieldbus without additional wiring which easier in terms of maintenance and modification.

Another advantage of fieldbuses is that they allow the distribution of the intelligence of the control process which comes closer to the sensor devices. It can be said that fieldbuses emerged as a response to the some of following needs (Mariño *et al.*, 2004):

- i) wiring reduction in installations
- ii) easily reconfigurable systems
- iii) reduced transmission times
- iv) reliability in data transmission
- v) intrinsic security in hazardous areas
- vi) improvement of transmitted signal
- vii) increase of information flow
- viii) integration of manufacturing data in the information system of the enterprise
- ix) increase of processing capacity (intelligence) of the sensors and actuators
- x) decentralization of the processing resources for making distributed process systems
- xi) control equipment with standard connections to guarantee the inter-networking of different products, and the compatibility of equipment and designed software.

The fulfilment of these needs makes fieldbuses very useful in industrial automation applications such as in CIM system (Habbadi and Sahraoui, 1992). The criteria for choosing a fieldbus solution are complex where the key factors include speed, topology, distance, redundancy, data transfer rate, number of stations, determinism, cost, simple operation, diagnostics, and the ability to integrate third-party products.

## 2.2 Fieldbuses Standard

During the last two decades, many fieldbus standard have been developed and successfully implemented for meeting real-time communication needs in the industrial automation system. Out of these the following protocols are leading contenders for the fieldbus standard:

- i) **Bitbus** - developed by Intel in 1984, can be claimed to be the original fieldbus. This is based around the 8044 microprocessor and operates with one master on the bus with multiple slaves.
- ii) **CAN (Controller Area Network)** –developed by Robert Bosch GmbH for automotive applications. In 1992 a CAN in Automation (CiN) group was formed as a support group for applications in industrial control and other non-automotive applications. The network management is very simple with each node reading all transmissions and filtering relevant messages depending on a 29 bit identifier.
- iii) **FIP/WorldFIP (Factory Instrumentation Protocol)** - FIP is a specified French national standard. The FIP Club, a group of manufacturers and users mainly based on France and Italy was set up to support the FIP. WorldFIP fieldbus is developed jointly by Honeywell, Allen-Bradley and FIP Club.
- iv) **LonWorks (Local Operating Networks)** – this technology is from Echelon Corporation, founded by Markkula, A.C. in 1986 and is a privately owned company. LonWorks technology possesses all the seven layers of the OSI protocol stack.
- v) **Profibus (Process Fieldbus)** - Profibus was started in 1987 by a German Government funded consortium of companies headed by Siemens AG. Profibus is a token passing network that allows multiple masters and multiple slaves on a bus and implements the full OSI level 7 protocol. There are many motor control applications using this fieldbus.



## REFERENCES

- Bertoluzzo, M., Buja, G. and Vitturi, S. (2002). "Ethernet Network for Factory Automation." *IEEE International Symposium on Industrial Electronics*, pp. 175–180.
- Casey, B. J. (1990). "Implementing Ethernet in the Industrial Environment." *IEEE Technical Application Conference and Workshops Northcon*, pp. 1469-1477.
- Crayford, I. (1995). "Accelerating Ethernet – Option and Implication." *IEEE Technical Application Conference and Workshops Northcon*, pp. 42-48.
- Forouzan, B. A. (2001). "*Data Communications and Networking*." 2<sup>nd</sup> Ed. Singapore: McGraw-Hill.
- Flammini, A., Ferrari, P., Sisinni, E., Marioli, D. and Taroni, A. (2002). "Sensor Interfaces: From Field-bus to Ethernet and Internet." *Sensors and Actuators*, vol. 101, pp. 194–202.
- Habbadi, A. and Sahraoui, A.E.K. (1992). "Fieldbus for CIM Applications: A Case Study," *Proceedings of the IEEE International Workshop on Emerging Technologies and Factory Automation*, pp. 354–359.
- Hao, X. and Hou, S. (2004). "OPC DX and Industrial Ethernet Glues Fieldbus Together." *International Conference on Control, Automation, Robotics and Vision*, vol. 8, pp. 562-567.

- Hao, X. and Wu, L. (2004). "Performance Evaluation of Industrial Ethernet and Its Modeling." *Proceedings of the International Conference on Information Acquisition*, pp. 527-531.
- Johannessen, S. (2004). "Adminstrating Ethernet Automation." *IEEE International Workshop on Proceedings of Factory Communication Systems*, pp. 423-428.
- Kaplan, G. (2001). "Ethernet's Winning Ways." *IEEE Spectr.*, vol. 38, no. 1, pp. 113-115.
- Kweon, S. K., Shin, K. G. and Zheng, Q. (1999). "Statistical Real-Time Communication over Ethernet for Manufacturing Automation Systems." *Proceeding IEEE Real-time Technology and Application Symposium*, pp. 192-202.
- Kweon, S. K. and Shin, K. G. (2003). "Statistical Real-Time Communication over Ethernet." *IEEE Transaction on Parallel and Distribution System*, vol. 14, no. 3, pp. 322-335.
- Lee, K. C. and Lee, S. (2002). "Performance Evaluation of Switched Ethernet for Real-time Industrial Communications." *Computer Standard Interfaces*, vol. 24, no. 5, pp. 411-423.
- Lee, K.C., Lee, S. and Lee, M.H. (2006). "Worst Case Communication Delay of Real-Time Industrial Switched Ethernet with Multiple Levels." *IEEE Transactions on Industrial Electronics*, vol. 53, no. 5, pp. 1669-1676.
- Maciel, C. D. (1998). "TCP/IP Networking in Process Control Plants." *Computer Industrial Engineering*, vol. 35, pp. 611-614.
- Mahalik, N. P. and Moore, P. R. (1997). "Fieldbus Technology Based, Distributed Control in Process Industries: A Case Study with LonWorks Technology." *Integrated Manufacturing Systems*, vol. 8, no. 4, pp. 231-243.

- Mariño, P., Domínguez, M. A., Poza, F. and Vázquez, F. (2004). "Using LOTOS in the specification of Industrial Bus Communication Protocols," *Computer Network*, vol. 45, pp. 767–799.
- Muškinja, N., Tovornik, B. and Terbuc, M. (2003). "Use of TCP/IP Protocol in Industrial Environment." *IEEE International Conference on Industrial Technology*, pp. 896-900.
- OMRON Asia Pacific Ptd. Ltd. (2000). "*CX-Programmer User Manual*." Singapore: Cat. No. W361/W362-E5-2-S.
- OMRON Corporation. (2003a). "*SYSMAC CS/CJ Series Ethernet Units (100Base-TX)*." Shizuoka (Japan): Cat. No. R111-E1-01.
- OMRON Electronics LLC. (2003b). "*SYSMAC CJ Series Programmable Controllers Operational Manual*." Schaumburg (U.S.A.): Cat. No. W393-E3-04.
- OMRON Electronics LLC. (2003c). "*SYSMAC CS and CJ Series Ethernet Units Operational Manual: Construction of Networks*." Schaumburg (U.S.A.): Cat. No. W420-E1-01.
- OMRON Corporation. (2005a). "*SYSMAC CS/CJ Series Serial Communications Boards/Units Operational Manual*." Kyoto (Japan): Cat. No. W336-E1-07.
- OMRON Corporation. (2005b). "*SYSMAC CS/CJ Series Ethernet Units Operational Manual*." Kyoto (Japan): Cat. No. W343-E1-06.
- OMRON Corporation. (2005c). "*SYSMAC CS/CJ Series Programmable Controllers Programming Manual*." Kyoto (Japan): Cat. No. W394-E1-08.
- OMRON Corporation. (2005d). "*SYSMAC CS and CJ Series Ethernet Units Operational Manual: Construction of Applications*." Kyoto (Japan): Cat. No. W421-E1-03.

- OMRON Corporation. (2006). “SYSMAC CS/CJ Series Communications Commands Reference Manual.” Kyoto (Japan): Cat. No. W342-E1-10.
- Park, J. H. and Yoon, Y. C. (1998). “An Extended TCP/IP Protocol for Real-Time Local Area Network,” *Control Engineering Practice*, vol. 6, no. 1, pp. 111–118.
- Potter, D. (1999). “Using Ethernet for Industrial I/O and Data Acquisition.” *Proceeding of the 16th IEEE Instrumentation and Measurement Technical Conference*, pp. 1492-1496.
- Skeie, T., Johannessen, S. and Holmeide, O. (2006). “Timeliness of Real-Time IP Communication Switched Industrial Ethernet Networks.” *IEEE Transaction on Industrial Informatics*, vol.2, no. 1, pp. 25-39.
- Stalling, W. (2000). “*Local and Metropolitan Area Networks.*” 6th Ed. New York: Macmillan.
- Sterling, D. J. and Wissler, S. P. (2003). “*The Industrial Ethernet Networking Guide.*” U.S.A.: Thomson-Demar Learning.
- Szabo, C. (1997). “An Ethernet Compatible Protocol to Support Real-time Traffic and Multimedia Applications.” *Computer Network ISDN Systems*, vol. 29, pp. 335-342.
- Vitturi, S. (2001). “On the Use of Ethernet at Low Level of Factory Communication Systems.” *Computer Standards and Interfaces*, vol. 23, pp. 267-277.
- Vitturi, S. (2004). “On the Effects of the Acyclic Traffic on Profibus-DP Networks,” *Computer Standard and Interfaces*, vol. 26, no. 2, pp. 131–144.
- Willig, A. (2003). “Polling-Based MAC Protocols for Improving Real-Time Performance in a Wireless PROFIBUS,” *IEEE Transaction Industrial Electronic*, vol. 50, no. 4, pp. 806–817.